


INSTALL CHRISTY G-5 VALVE BOX W/GSC LID OR EQUAL. VALVE BOX AND RISER CENTERED OVER GATE VALVE OR CORPORATION STOP VALVE AND ALIGNED WITH VALVE STEM AXIS. GRADE RINGS PROHIBITED

PROVIDE TESTING CONNECTION FOR TRACER WIRE

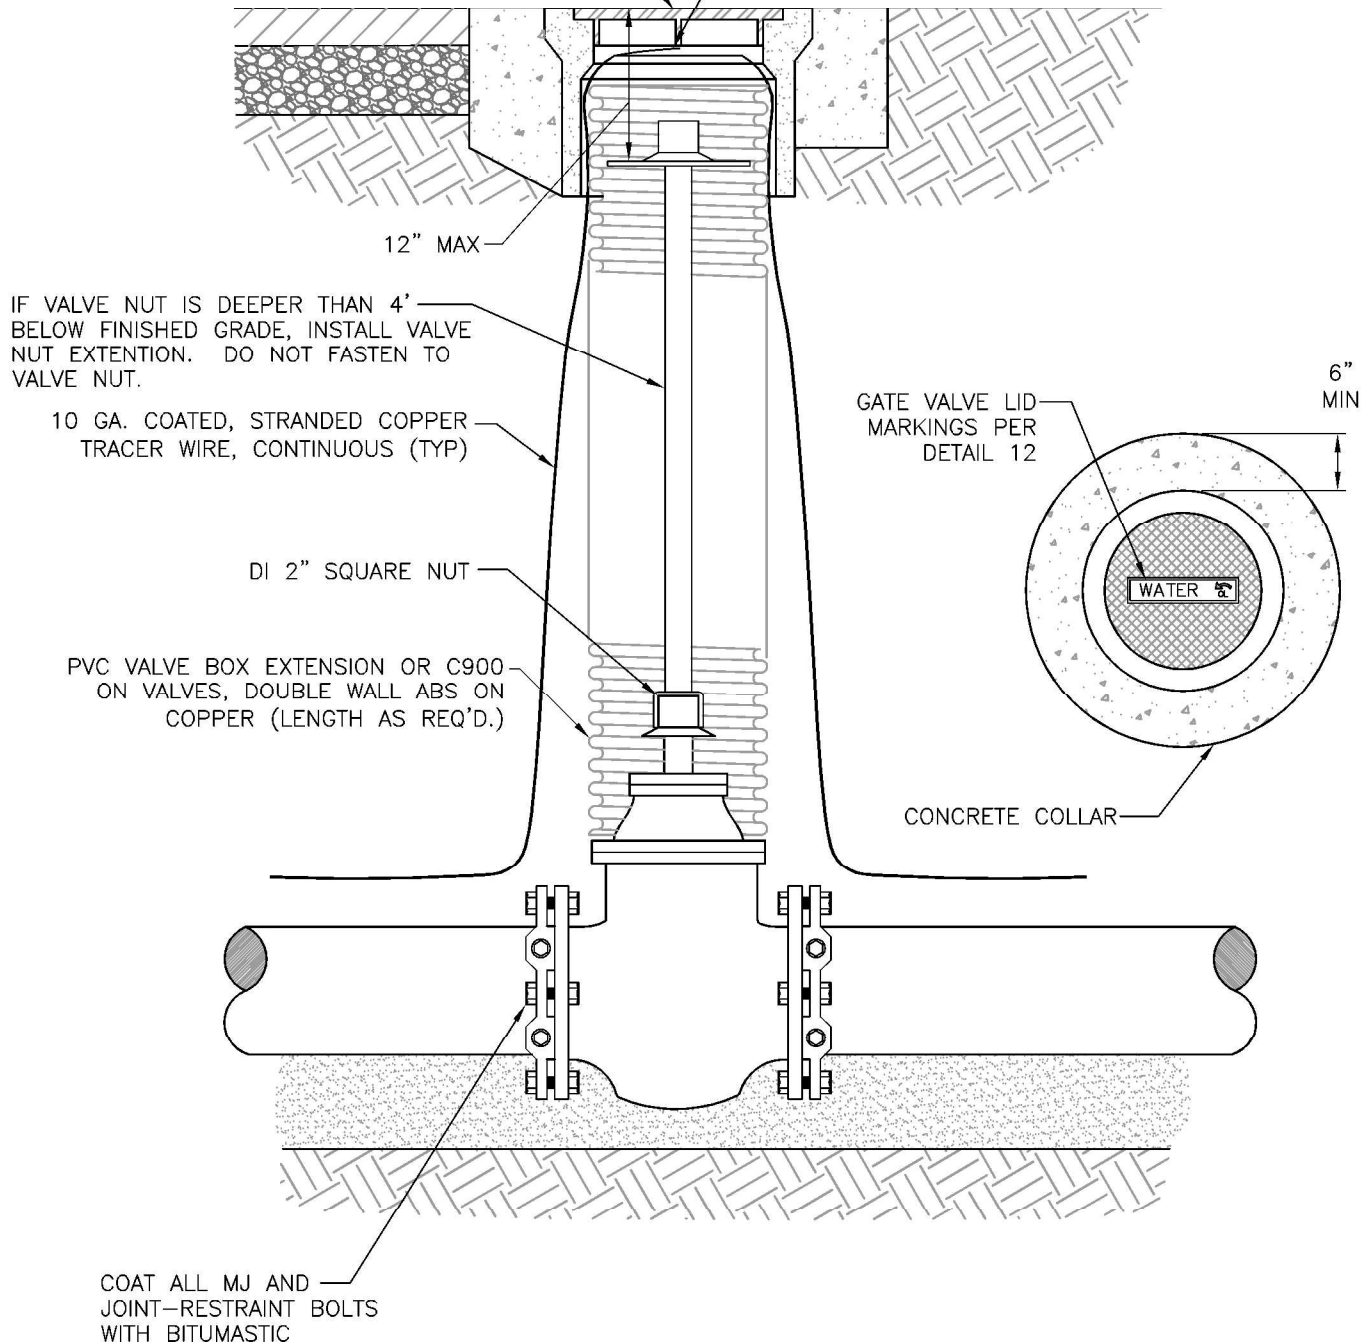

NOTES

1. INSTALL BLOCKING UNDER VALVE IF REQUIRED.
2. RISER TERMINATION FOR GATE VALVE SHALL OCCUR AT VALVE FLANGE.
3. RISER TERMINATION FOR SERVICE CONNECTION (2" & SMALLER) SHALL OCCUR 1" BELOW CORP STOP.
4. VALVE BOX LID SHALL BE OILED PRIOR TO PAVING OR CLEANING TO ENSURE THAT LID MARKINGS ARE LEGIBLE.
5. INSTALL VALVE BOX LID FLUSH WITH FINAL PAVING OR GROUND SURFACE.



SCOTTS VALLEY WATER DISTRICT

WWW.SVWD.ORG

DETAIL 11

GATE VALVE INSTALLATION

NOT TO SCALE