


PLAN VIEW

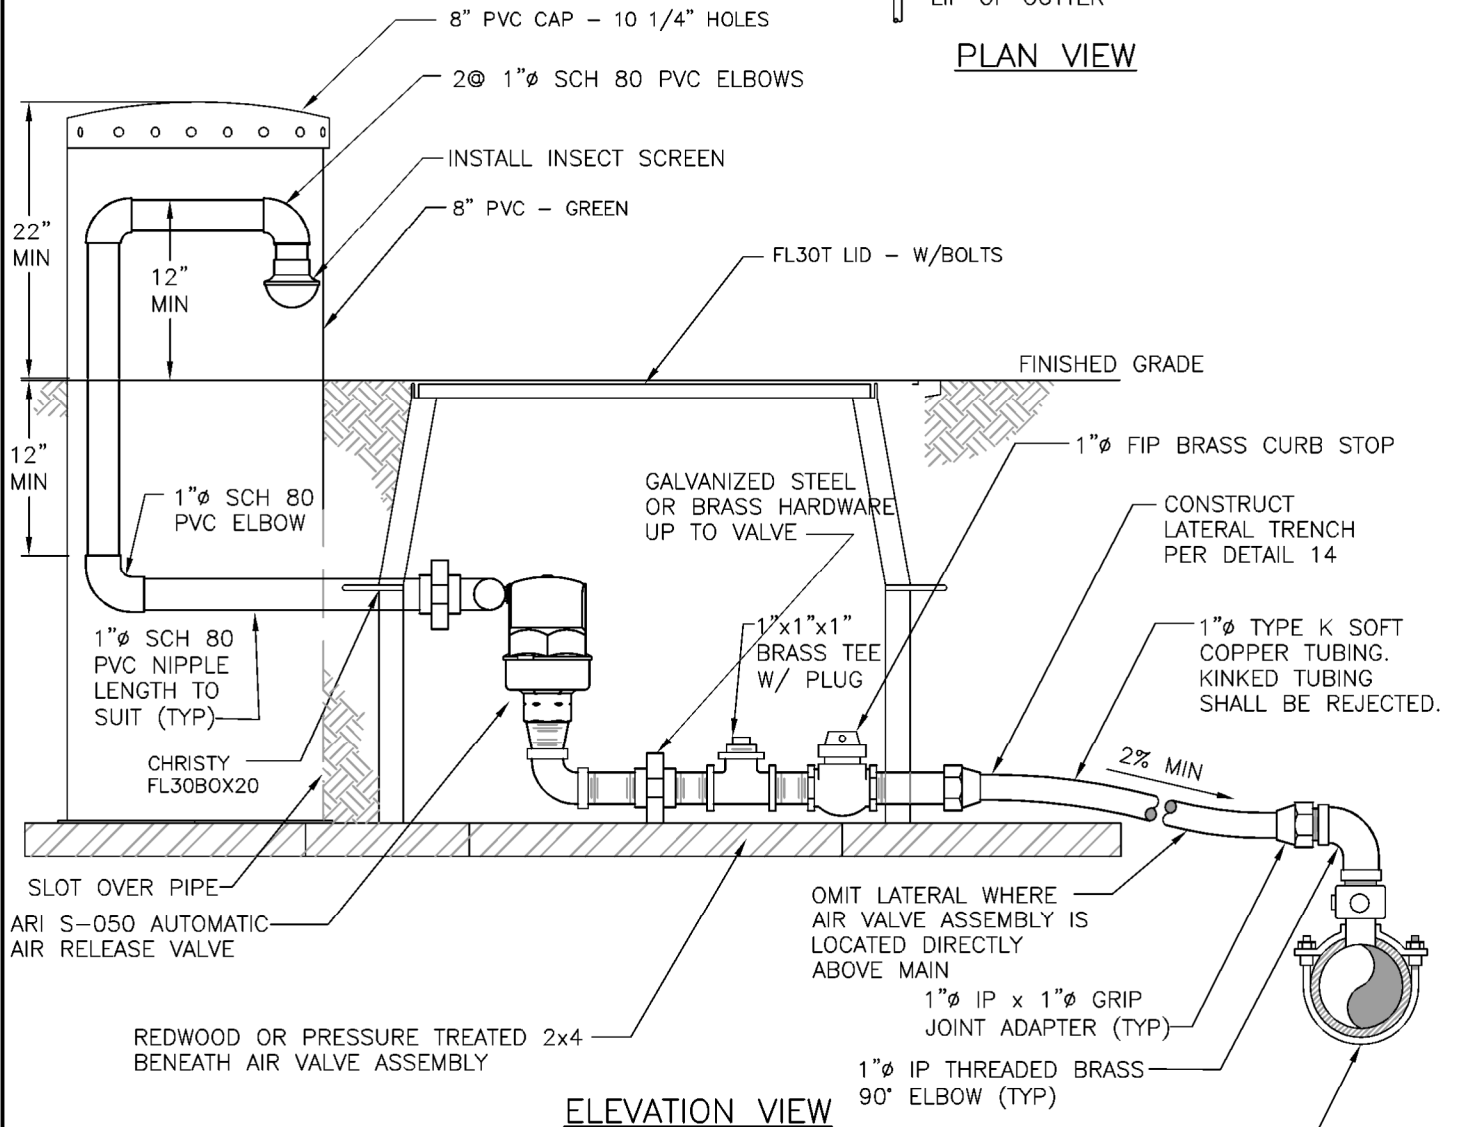

ELEVATION VIEW

NOTES

1. EXACT LOCATIONS OF TAP AND OF AIR VALVE SHALL BE APPROVED BY THE ENGINEER PRIOR TO INSTALLATION.
2. BRASS FITTINGS, VALVES AND PIPE SHALL CONSIST OF LOW-LEAD BRASS ALLOY AND SHALL HAVE A MINIMUM WORKING PRESSURE OF 150 PSI.
3. ABOVE GROUND PIPING, FITTINGS AND ENCLOSURE SHALL BE PAINTED W/ TWO COATS OF RUST PREVENTATIVE ENAMEL.
4. AT THE DISCRETION OF THE ENGINEER, A GATE VALVE AND BOX SHALL BE INSTALLED NEAR THE CONNECTION AT THE MAIN PER DETAIL 11.

STANDARD SERVICE CONNECTION PER DETAIL 1.
MAKE TAP AT TOP OF MAIN.



SCOTTS VALLEY WATER DISTRICT
WWW.SVWD.ORG

DETAIL 25

BELOW GRADE AIR VALVE INSTALLATION

NOT TO SCALE